ACOUSTIC PERFORMANCE DATA SHEET

Rw (C; Ctr)


31 (-1; -2) dB

SPECIFICATION

Door core	MARKSMAN®
Finished thickness	44 mm
Doorset configuration	SASD
Glazing configuration	Unglazed
Seal supplier	Lorient
Frame intumescent seal	15x4 Fire Only
Frame acoustic seal	Lorient Batwing LAS1212
Meeting stile arrangement	N/A
Threshold seal	Lorient LAS8001 SI
Laboratory	Cambridge Acoustic Laboratory
Test report reference	24014-R01-A | Test No. 29

FREQUENCY BAND SOUND REDUCTION

Frequency (Hz)	R (dB)
100	22.2
125	23.9
160	26.3
200	26.2
250	27.7
315	30.4
400	31.1
500	32
630	32.5
800	31.2
1000	28.8
1250	28
1600	28.5
2000	30.3
2500	31.5
3150	32.1

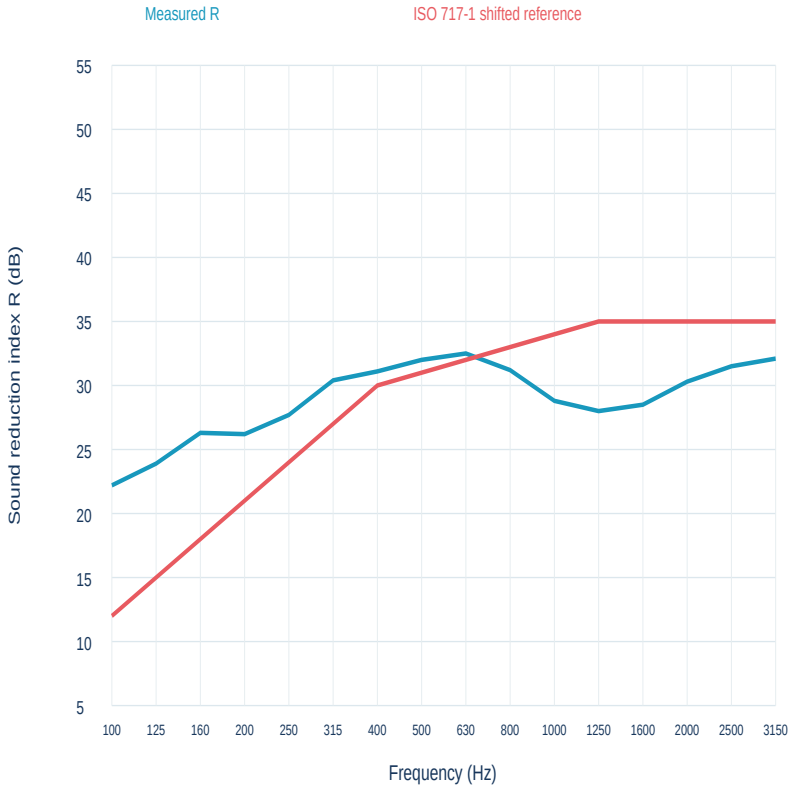

For further information, including test evidence, permitted configurations, specification guidance and appropriate applications of this doorset system, please contact Wood International Agency Ltd.