ACOUSTIC PERFORMANCE DATA SHEET

Rw (C; Ctr)


32 (-1; -2) dB

SPECIFICATION

Door core	MARKSMAN®
Finished thickness	44 mm
Doorset configuration	SASD
Glazing configuration	Glazed - 7mm Glass
Seal supplier	Fire and Acoustic Seals Limited
Frame intumescent seal	15x4 Fire Only
Frame acoustic seal	Fire and Acoustic Seals FAS35
Meeting stile arrangement	N/A
Threshold seal	Fire & Acoustic Seals FAS45
Laboratory	Cambridge Acoustic Laboratory
Test report reference	24014-R01-A | Test No. 6

FREQUENCY BAND SOUND REDUCTION

Frequency (Hz)	R (dB)
100	21.2
125	22.9
160	25.4
200	24.5
250	26.2
315	29.3
400	29.7
500	30.7
630	32.2
800	32.8
1000	32
1250	30.9
1600	30.8
2000	31.5
2500	32.7
3150	32.7

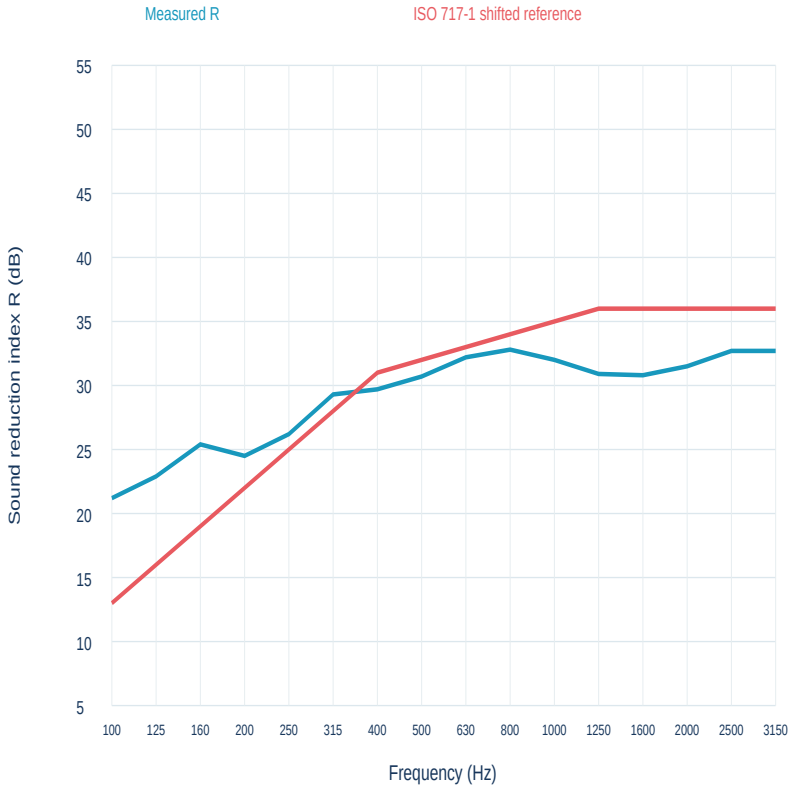

For further information, including test evidence, permitted configurations, specification guidance and appropriate applications of this doorset system, please contact Wood International Agency Ltd.