ACOUSTIC PERFORMANCE DATA SHEET

Rw (C; Ctr)


33 (0; -1) dB

SPECIFICATION

Door core	MARKSMAN®
Finished thickness	44 mm
Doorset configuration	SASD
Glazing configuration	Glazed - 7mm Glass
Seal supplier	Mann McGowan
Frame intumescent seal	15x4 Fire Only
Frame acoustic seal	Mann Mcgowan ACS1
Meeting stile arrangement	N/A
Threshold seal	Mann McGowan 1703 ACU
Laboratory	Cambridge Acoustic Laboratory
Test report reference	24014-R01-A | Test No. 23

FREQUENCY BAND SOUND REDUCTION

Frequency (Hz)	R (dB)
100	22.1
125	23.9
160	26.1
200	26.7
250	28.4
315	30.8
400	31.5
500	32.3
630	34.3
800	34.2
1000	33.1
1250	32.4
1600	32.9
2000	33.1
2500	34
3150	34.3

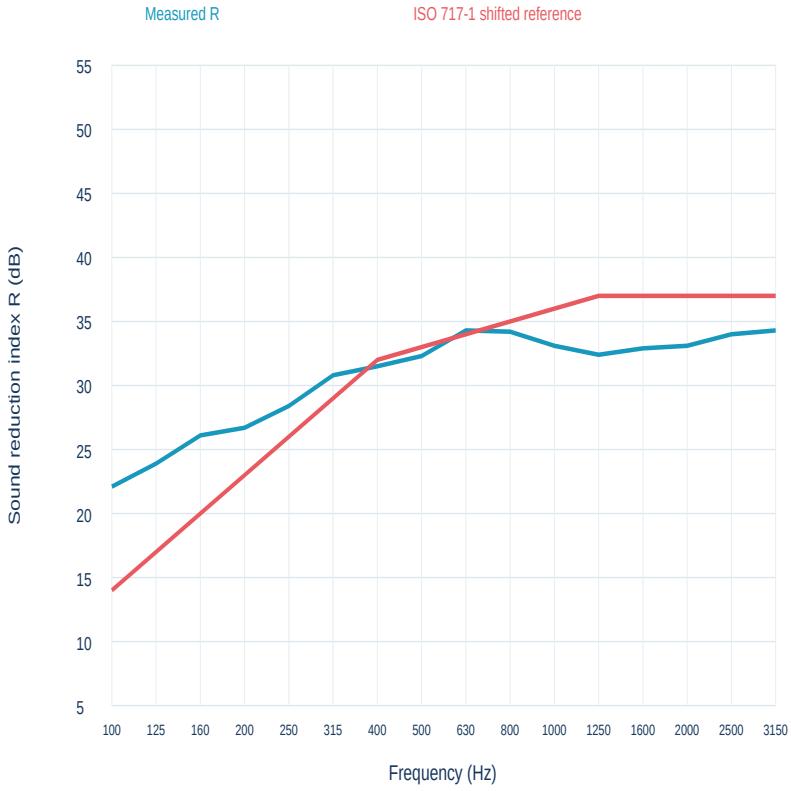

For further information, including test evidence, permitted configurations, specification guidance and appropriate applications of this doorset system, please contact Wood International Agency Ltd.