ACOUSTIC PERFORMANCE DATA SHEET

Rw (C; Ctr)

35 (-1; -3) dB


SPECIFICATION

BASELINE TEST - FULLY CAULKED

Door core	MARKSMAN®
Finished thickness	44 mm
Doorset configuration	SASD
Glazing configuration	Glazed - 7mm Glass
Seal supplier	N/A
Frame intumescent seal	Fully Caulked
Frame acoustic seal	Fully Caulked
Meeting stile arrangement	N/A
Threshold seal	N/A
Laboratory	Cambridge Acoustic Laboratory
Test report reference	24014-R01-A | Test No. 24

FREQUENCY BAND SOUND REDUCTION

Frequency (Hz)	R (dB)
100	21.3
125	22.4
160	26.3
200	27
250	28.8
315	31.2
400	31.8
500	33
630	34.5
800	34.7
1000	34.4
1250	33.5
1600	34.2
2000	34.6
2500	35.8
3150	36.8

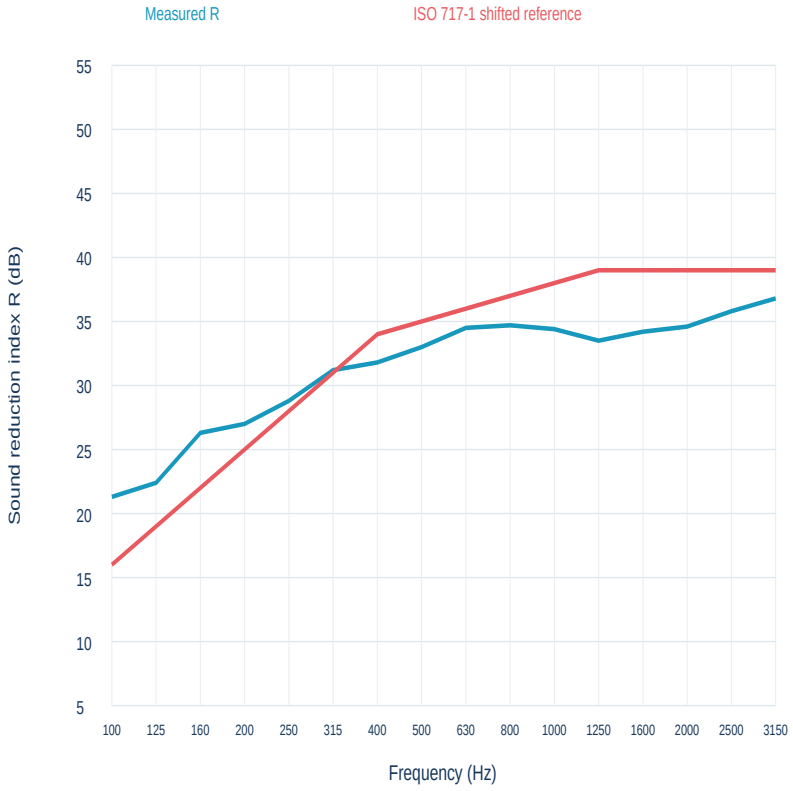

For further information, including test evidence, permitted configurations, specification guidance and appropriate applications of this doorset system, please contact Wood International Agency Ltd.